

PRODUCT DATA SHEET

Purofine® PFA694E

Polystyrenic Gel, Potable Water
Grade

PRINCIPAL APPLICATIONS

- Removal of perfluoroalkyl substances
- Removal of polyfluoroalkyl substances

ADVANTAGES

- Very high operating capacity
- Excellent kinetics
- Reduces PFAS to non-detect levels ranging from 1 – 5 parts per trillion

SYSTEMS

- Point of Use Systems (POU)
- Point of Entry Systems (POE)
- Municipal

REGULATORY APPROVALS

- Certified by the WQA to NSF/ANSI-61 Standard

TYPICAL PACKAGING

- 1 ft³ Sack
- 25 L Sack
- 5 ft³ Drum (Fiber)
- 1 m³ Supersack
- 42 ft³ Supersack

** Reduces PFAS to non-detect levels ranging from 1 – 5 parts per trillion*

TYPICAL PHYSICAL & CHEMICAL CHARACTERISTICS:


Polymer Structure	Polystyrene crosslinked with divinylbenzene
Appearance	Spherical Beads
Functional Group	Complex Amino
Mean Diameter	675 ± 75 µm
Uniformity Coefficient (max.)	1.3
Specific Gravity	1.05
Shipping Weight (approx.)	650 - 700 g/L (40.6 - 43.8 lb/ft ³)
Temperature Limit	100 °C (212.0 °F) (Cl ⁻ form)
Temperature Limit	60 °C (140.0 °F) (OH ⁻ form)

Hydraulic Characteristics

PRESSURE DROP

The pressure drop across a bed of ion exchange resin depends on the particle size distribution, bed depth, and voids volume of the exchange material, as well as on the flow rate and viscosity of the influent solution. Factors affecting any of these parameters—such as the presence of particulate matter filtered out by the bed, abnormal compressibility of the resin, or the incomplete classification of the bed—will have an adverse effect, and result in an increased head loss. Depending on the quality of the influent water, the application and the design of the plant, service flow rates may vary from 10 to 40 BV/h.


PRESSURE DROP ACROSS RESIN BED

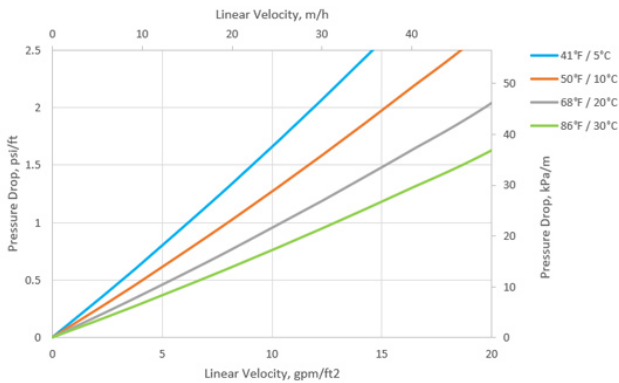

BACKWASH

A 20 BV downflow rinse is required before the vessel is put into service. This rinse can be done onsite or offsite pre-installation. Once the resin is put into service, backwashing is not permitted as this will lead to shortened bed life. This is a uniform grade resin with beads of similar size and will not require backwashing for classification / stratification before use. If it is determined, before startup, that air bubbles or particulate matter are trapped within the bed, then backwashing can be done. In that case, the resin bed should be expanded by 50-70% for 10-15 minutes. Please note that bed expansion increases with higher flow rate and lower water temperature. Avoid loss of resin through the top of the vessel by over expansion of the bed.

BACKWASH EXPANSION OF RESIN BED

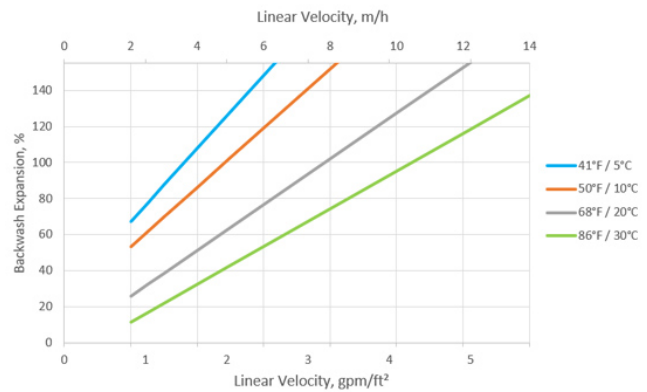

Purolite, an Ecolab company, is a leading manufacturer of quality ion exchange, catalyst, adsorbent and specialty high-performance resins with global sales support.



We're ready to solve your process challenges.

For further information on Purolite products and services, visit www.purolite.com or contact us at the addresses below.

Americas
americas@purolite.com

Asia Pacific
asiapacific@purolite.com

EMEA
emea@purolite.com

The statements, technical information and recommendations contained herein are believed to be accurate as of the date hereof. Since the conditions and methods of use of the product and of the information referred to herein are beyond our control, Purolite expressly disclaims any and all liability as to any results obtained or arising from any use of the product or reliance on such information; NO WARRANTY OF FITNESS FOR ANY PARTICULAR PURPOSE, WARRANTY OF MERCHANTABILITY OR ANY OTHER WARRANTY, EXPRESSED OR IMPLIED, IS MADE CONCERNING THE GOODS DESCRIBED OR THE INFORMATION PROVIDED HEREIN. The information provided herein relates only to the specific product designated and may not be applicable when such product is used in combination with other materials or in any process. Nothing contained herein constitutes a license to practice under any patent and it should not be construed as an inducement to infringe any patent and the user is advised to take appropriate steps to be sure that any proposed use of the product will not result in patent infringement.